


SECTION A-A

NOTES:

1. PERMIT FEE AND INSPECTION REQUIRED
2. DROP CONNECTION TO BE MADE BELOW CONE SECTION.
3. DROP CONNECTION SHALL NOT INTERFERE WITH MANHOLE STEPS.
4. DROP CONNECTION MUST NOT DISTURB INTEGRITY OF JOINTS AND MUST NOT BE WITHIN 12" OF A JOINT.
5. EXISTING BENCH TO BE RAISED AND A CHANNEL TO BE CREATED FROM THE OUTLET OF THE 90° BEND TO THE MAIN FLOW LINE.
6. LATERAL TAP IN MANHOLE WALL SHALL BE CORE-DRILLED AND A PRESSURE FITTED BOOT WITH STAINLESS STEEL BANDS USED TO MAKE A WATER TIGHT SEAL.
7. IF THE SLOPE OF THE INCOMING SEWER EXCEEDS 5% FROM THE HORIZONTAL, A FITTING SHALL BE USED OUTSIDE THE MANHOLE WALL TO FACILITATE A MORE PERPENDICULAR CONNECTION TO THE MANHOLE WALL. THE USE OF THIS FITTING IS TO BE EVALUATED ON A CASE BY CASE BASIS BY SD1 ENGINEERS.

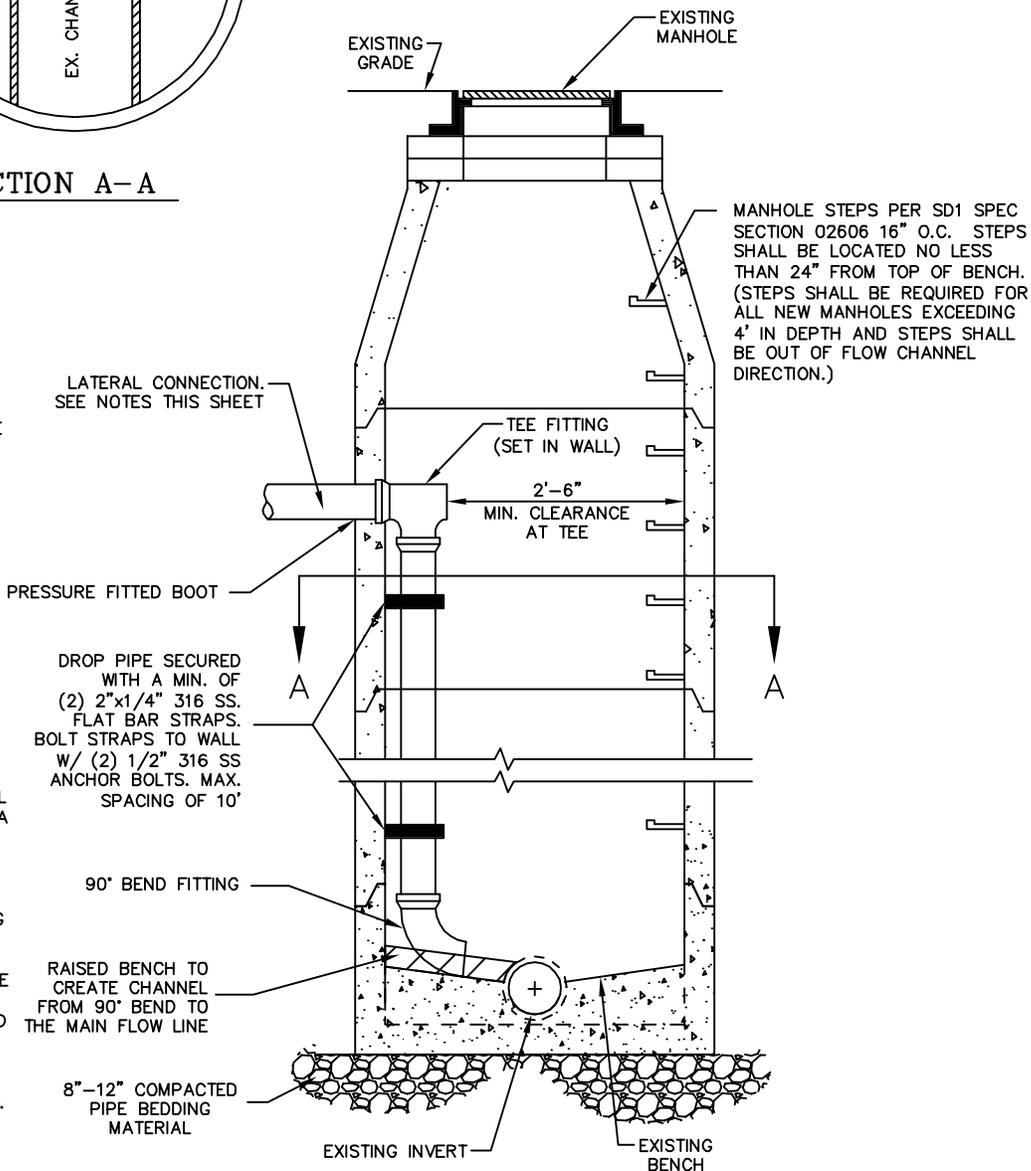


**INSIDE DROP MANHOLE
ONLY FOR INSTALLATIONS
APPROVED BY SD1**

N.T.S.

NOTE:

-SEE DETAIL 113-A FOR PRECAST BASE DETAIL

REVISION	BY	DATE



SANITATION DISTRICT NO. 1
 1045 Eaton Drive
 FT. Wright, Kentucky 41017
 Ph: (859) 578-7460
 Fax: (859) 331-2436

DATE:
MARCH 2010

**STANDARD
DRAWING NO:**

105